


NOTES:

- All Material Must Meet KKW Specifications.
- All M.J. Connections Must Utilize Joint Restraint.
- All Fittings (Tee, Valve, Hydrant Base) Must Be Wrapped In Polyethylene.
- Hydrant Must Be Plumb With Break Line Matching Finish Grade.

VALVE & HYDRANT MUST BE OPEN RIGHT.

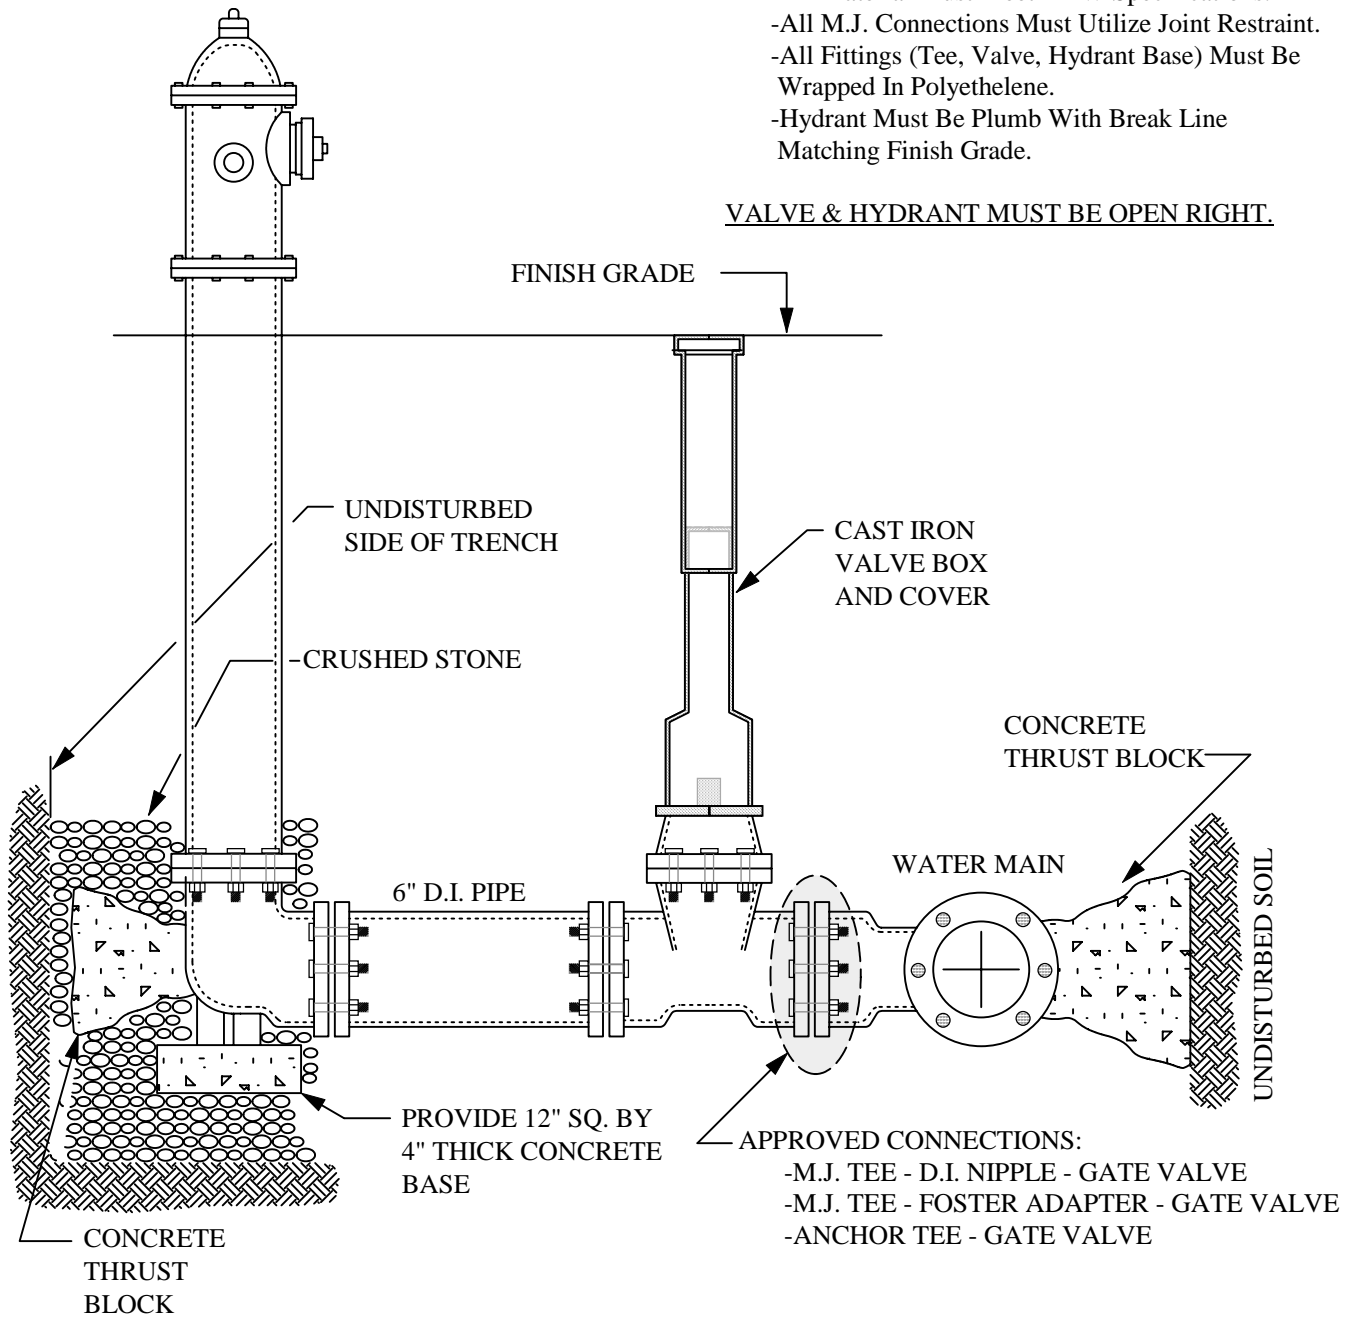

KENNEBUNK
KENNEBUNKPORT
WELLS
WATER DISTRICT

HYDRANT INSTALLATION

NOT TO SCALE